



NZM4 PXR25 circuit breaker - integrated energy measurement class 1, 1400A, 3p, Screw terminal



Part no. NZMN4-PMX1400
Catalog No. 189683

Similar to illustration

Delivery program

| | | | |
|---|-------------|---|--|
| Product range | | | Circuit-breaker |
| Protective function | | | Motor protection |
| Standard/Approval | | | IEC |
| Installation type | | | Fixed |
| Release system | | | Electronic release |
| Construction size | | | NZM4 |
| Description | | | Motor protection - overload- and short-circuit protective device LI Motor Class 1 energy measurement, phase loss protection, r.m.s. value measurement, and "thermal memory" USB interface for configuration and test function with Power Xpert Protection Manager software Interface module in equipment supplied. Optionally communication-capable with interface module and internal Modbus RTU module or CAM |
| Number of poles | | | 3 pole |
| Standard equipment | | | Screw connection |
| Rated current = rated uninterrupted current | $I_n = I_u$ | A | 1400 |

Setting range


| | | | |
|------------------------|--------------------------|---|------------|
| Overload trip | | | |
| | I_r | A | 700 - 1400 |
| Short-circuit releases | | | |
| | | | |
| Non-delayed | $I_i = I_n \times \dots$ | | 2 - 14 |
| | | | |

Motor rating AC-3 50/60 Hz

| | | | |
|-----------------------------------|---|----|-----|
| 380 V 400 V | P | kW | 800 |
| Motor rating AC-3 50/60 Hz | | | |
| 400 V | P | kW | 800 |

Technical data

| | | | |
|---|--|------|--|
| General | | | |
| Standards | | | IEC/EN 60947 |
| Protection against direct contact | | | Finger and back of hand proof to VDE 0106 Part 100 |
| Climatic proofing | | | Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30 |
| Ambient temperature | | | |
| Ambient temperature, storage | | °C | - 40 - + 70 |
| Operation | | °C | -25 - +70 |
| Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27 | | g | 15 (half-sinusoidal shock 11 ms) |
| Safe isolation to EN 61140 | | | |
| Between auxiliary contacts and main contacts | | V AC | 500 |
| between the auxiliary contacts | | V AC | 300 |

| | | | |
|--|--|--|--|
| Mounting position | | Vertical and 90° in all directions |  <p>With XF1 earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions</p> |
| Direction of incoming supply | | as required | |
| Degree of protection | | | |
| Device | | In the operating controls area: IP20 (basic degree of protection) | |
| Enclosures | | With insulating surround: IP40 With door coupling rotary handle: IP66 | |
| Terminations | | Tunnel terminal: IP10 Phase isolator and strip terminal: IP00 | |
| Other technical data (sheet catalogue) | | Weight Temperature dependency, Derating Effective power loss | |

Circuit-breakers

| | | | |
|---|-------------|------|-------|
| Rated current = rated uninterrupted current | $I_n = I_u$ | A | 1400 |
| Rated surge voltage invariability | U_{imp} | | |
| Main contacts | | V | 8000 |
| Auxiliary contacts | | V | 6000 |
| Rated operational voltage | U_e | V AC | 690 |
| Overvoltage category/pollution degree | | | III/3 |
| Rated insulation voltage | U_i | V | 690 |
| Use in unearthed supply systems | | V | ≤ 525 |

Switching capacity

| | | | |
|---|------------|----|---|
| Rated short-circuit making capacity | I_{cm} | | |
| 240 V | I_{cm} | kA | 105 |
| 400/415 V | I_{cm} | kA | 105 |
| 440 V 50/60 Hz | I_{cm} | kA | 74 |
| 525 V 50/60 Hz | I_{cm} | kA | 53 |
| 690 V 50/60 H | I_c | kA | 40 |
| Rated short-circuit breaking capacity I_{cn} | I_{cn} | | |
| I_{cu} to IEC/EN 60947 test cycle 0-t-CO | I_{cu} | kA | |
| 690 V 50/60 Hz | I_{cu} | kA | 20 |
| I_{cs} to IEC/EN 60947 test cycle 0-t-CO-t-CO | I_{cs} | kA | |
| 240 V 50/60 Hz | I_{cs} | kA | 37 |
| 400/415 V 50/60 Hz | I_{cs} | kA | 37 |
| 440 V 50/60 Hz | I_{cs} | kA | 26 |
| 525 V 50/60 Hz | I_{cs} | kA | 19 |
| 690 V 50/60 Hz | I_{cs} | kA | 15 |
| | | | Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker. |
| Rated short-time withstand current | | | |
| t = 0.3 s | I_{cw} | kA | 19.2 |
| t = 1 s | I_{cw} | kA | 19.2 |
| Utilization category to IEC/EN 60947-2 | | | B |
| Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release) | Operations | | 10000 |
| Lifespan, electrical | | | |
| AC-1 | | | |
| 400 V 50/60 Hz | Operations | | 3000 |
| 415 V 50/60 Hz | Operations | | 3000 |
| 690 V 50/60 Hz | Operations | | 2000 |

| | | | |
|-----------------------------------|------------|-------|----------------------------|
| AC--3 | | | |
| 400 V 50/60 Hz | Operations | | 2000 |
| 415 V 50/60 Hz | Operations | | 2000 |
| 690 V 50/60 Hz | Operations | | 1000 |
| Max. operating frequency | | Ops/h | 60 |
| Total break time at short-circuit | | ms | < 25 ≤ 415 V; < 35 > 415 V |

Terminal capacity

| | | | |
|---|------|-----------------|---|
| Standard equipment | | | Screw connection |
| Optional accessories | | | Tunnel terminal connection on rear Strip terminal |
| Round copper conductor | | | |
| Tunnel terminal | | | |
| Stranded | | | |
| 4-hole | | mm ² | 4 x (50 - 240) |
| Bolt terminal and rear-side connection | | | |
| Direct on the switch | | | |
| Stranded | | mm ² | 1 x (120 - 185) 4 x (50 - 185) |
| Module plate | | | |
| Single hole | min. | mm ² | 1 x (120 - 300) |
| Single hole | max. | mm ² | 2 x (95 - 300) |
| Module plate | | | |
| Double hole | min. | mm ² | 2 x (95 - 185) |
| Double hole | max. | mm ² | 4 x (35 - 185) |
| Connection width extension | | mm ² | |
| Connection width extension | | mm ² | 4 x 300 6 x (95 - 240) |
| Al circular conductor | | | |
| Tunnel terminal | | | |
| Stranded | | | |
| 4-hole | | mm ² | 4 x (50 - 240) |
| Cu strip (number of segments x width x segment thickness) | | | |
| Flat conductor terminal | | | |
| | min. | mm | 6 x 16 x 0.8 |
| | max. | mm | (2 x) 10 x 32 x 1.0 |
| Module plate | | | |
| Single hole | | mm | (2 x) 10 x 50 x 1.0 |
| Bolt terminal and rear-side connection | | | |
| Flat copper strip, with holes | min. | mm | 5 x 25 x 1.0 |
| Flat copper strip, with holes | max. | mm | (2 x) 10 x 50 x 1.0 |
| Connection width extension | | mm | (2 x) 10 x 80 x 1.0 |
| Copper busbar (width x thickness) | mm | | |
| Bolt terminal and rear-side connection | | | |
| Screw connection | | | M10 |
| Direct on the switch | | | |
| | min. | mm | 25 x 5 |
| | max. | mm | 2 x (50 x 10) |
| Module plate | | | |
| Single hole | min. | mm | 25 x 5 |
| Single hole | max. | mm | 2 x (50 x 10) |
| Module plate | | | |
| Double hole | | mm | 2 x (50 x 10) |
| Connection width extension | | mm | |
| Connection width extension | min. | mm | 60 x 10 |
| Connection width extension | max. | mm | 2 x (80 x 10) |

| | | | |
|----------------|--|-----------------|--------------------------------------|
| Control cables | | | |
| | | mm ² | 1 x (0.75 - 2.5) 2 x (0.75 - 1.5) |

Design verification as per IEC/EN 61439

| | | | |
|--|------------------|----|--|
| Technical data for design verification | | | |
| Rated operational current for specified heat dissipation | I _n | A | 1400 |
| Equipment heat dissipation, current-dependent | P _{vid} | W | 217.56 |
| Operating ambient temperature min. | | °C | -25 |
| Operating ambient temperature max. | | °C | 70 |
| IEC/EN 61439 design verification | | | |
| 10.2 Strength of materials and parts | | | |
| 10.2.2 Corrosion resistance | | | |
| 10.2.3.1 Verification of thermal stability of enclosures | | | Meets the product standard's requirements. |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat | | | Meets the product standard's requirements. |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects | | | Meets the product standard's requirements. |
| 10.2.4 Resistance to ultra-violet (UV) radiation | | | Meets the product standard's requirements. |
| 10.2.5 Lifting | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions | | | Meets the product standard's requirements. |
| 10.3 Degree of protection of ASSEMBLIES | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances | | | Meets the product standard's requirements. |
| 10.5 Protection against electric shock | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections | | | Is the panel builder's responsibility. |
| 10.8 Connections for external conductors | | | Is the panel builder's responsibility. |
| 10.9 Insulation properties | | | |
| 10.9.2 Power-frequency electric strength | | | Is the panel builder's responsibility. |
| 10.9.3 Impulse withstand voltage | | | Is the panel builder's responsibility. |
| 10.9.4 Testing of enclosures made of insulating material | | | Is the panel builder's responsibility. |
| 10.10 Temperature rise | | | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating | | | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.12 Electromagnetic compatibility | | | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.13 Mechanical function | | | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |

Technical data ETIM 8.0

| | | | |
|---|--|----|--|
| Low-voltage industrial components (EG000017) / Motor protection circuit-breaker (EC000074) | | | |
| Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Motor protection circuit-breaker (ecl@ss10.0.1-27-37-04-01 [AGZ529016]) | | | |
| Overload release current setting | | A | 560 - 1400 |
| Adjustment range undelayed short-circuit release | | A | 2 - 14 |
| With thermal protection | | | Yes |
| Phase failure sensitive | | | Yes |
| Switch off technique | | | Electronic |
| Rated operating voltage | | V | 690 - 690 |
| Rated permanent current I _u | | A | 1400 |
| Rated operation power at AC-3, 230 V | | kW | 450 |
| Rated operation power at AC-3, 400 V | | kW | 800 |
| Type of electrical connection of main circuit | | | Screw connection |
| Type of control element | | | Rocker lever |
| Device construction | | | Built-in device fixed built-in technique |
| With integrated auxiliary switch | | | No |
| With integrated under voltage release | | | No |


| | | |
|--|----|------|
| Number of poles | | 3 |
| Rated short-circuit breaking capacity Icu at 400 V, AC | kA | 26 |
| Degree of protection (IP) | | IP20 |
| Height | mm | 170 |
| Width | mm | 210 |
| Depth | mm | 375 |

Characteristics

Let-through current

Let-through energy

Dimensions

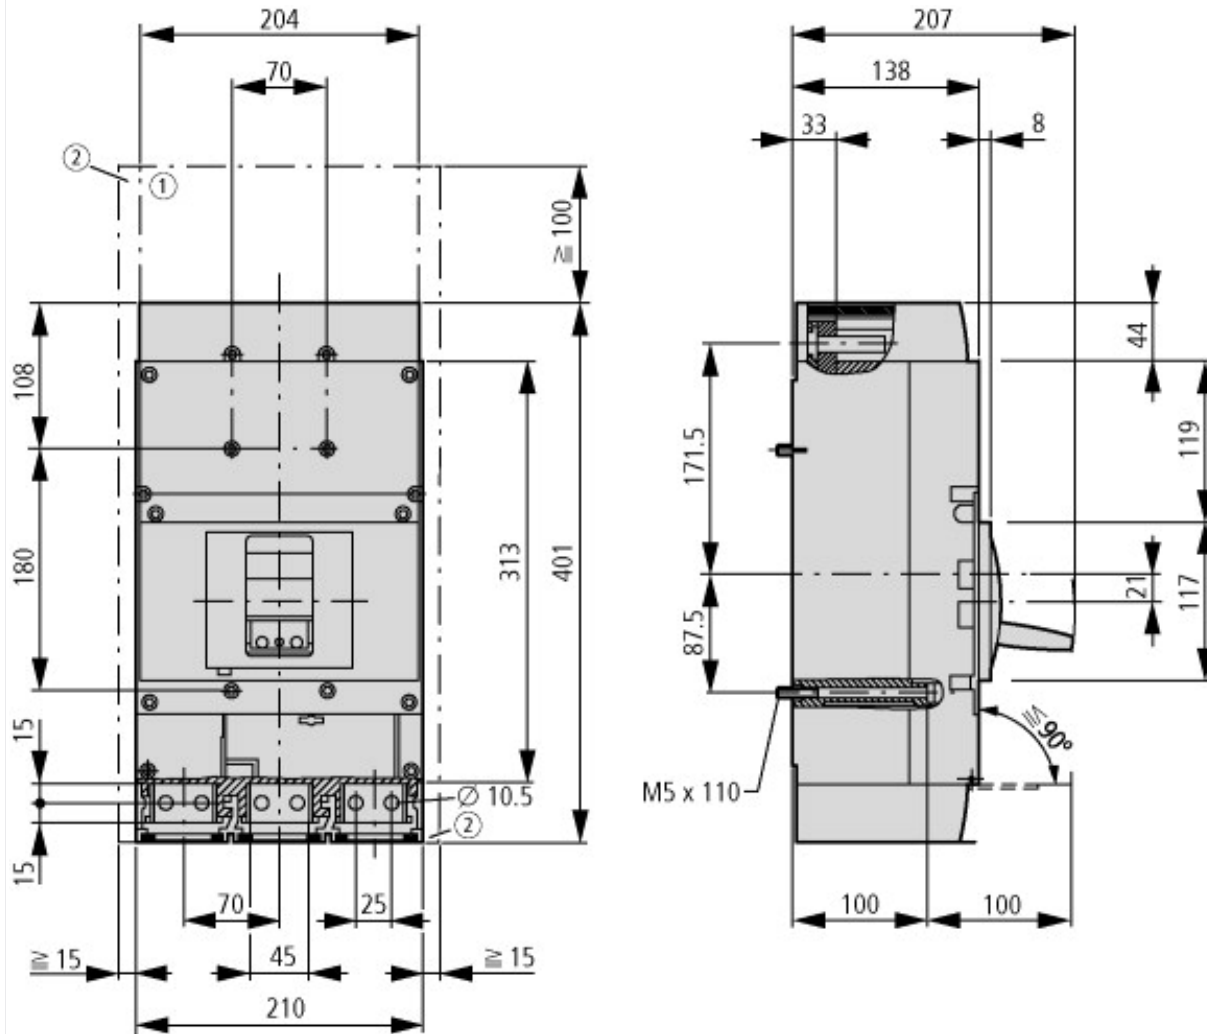

① Blow out area, minimum clearance to adjacent parts

Ui ≤ 690 V: 100 mm

Ui ≤ 1500 V: 200 mm

② Minimum clearance to adjacent parts

Ui ≤ 1000 V: 15 mm

Ui ≤ 1500 V: 70 mm

Additional product information (links)

IL012101ZU NZM4-PXR circuit-breaker, basic device, NZM4-PXR Circuit-Breaker, basic unit

IL012101ZU NZM4-PXR circuit-breaker, basic device, NZM4-PXR Circuit-Breaker, basic unit https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL012101ZU2022_01.pdf

Weight <http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.171>

Temperature dependency, Derating <http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172>

Effective power loss <http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.174>

additional technical information for NZM power switch https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technik_de_en.pdf