DATASHEET - NZMS2-4-VX160/VAR



NZM2 PXR20 circuit breaker, 160A, 4p, variable, screw terminal



NZMS2-4-VX160/VAR 191661



Similar to illustration

Delivery program

Product range Interview of the chick of	71 0			
Standard/Approval Installation type IC Field Installation type Field Field Field Release system Installation release Electronic release Construction size Installation release Release system Construction size Installation release Release system Description Installation release Release system Number of poles Installation release Release system Standard equipment Installation release Release system Addy(415 V50 Hz Installation release Release system Addy(415 V50 Hz Installation release Release release release Standard equipment Installation Installation Addy(415 V50 Hz Installation release Release release release Reled current = rateld uninterrupted current Installation Installation Reted current = rateld uninterrupted current Installation Installation Nutrel conductor Via of phase release Installation Overload trip Installation Installation Installation releases Installation Installation Installation release Installation release Installation release Instructure releases Installation Installat	Product range			Circuit-breaker
Installation ype Ked Release system Electronic release Construction size XMZ Dascription Silver Magnetizettion and delayed and non-delayed short-circuit protective Bis metased for configuration and test function and delayed and non-delayed short-circuit protective Bis metased for configuration and test function and test funct	Protective function			Systems, cable, selectivity and generator protection
Release systm Participation Part	Standard/Approval			IEC
Construction size Image: Solution Image: Solution and delayed and non-delayed short-circuit protection device Image: Solution and delayed and non-delayed short-circuit protection device Image: Solution and test function with Power Xpert Protection Winsage: Solution Action Action Action Action Action Winsage: Sol	Installation type			Fixed
Description Image: Second se	Release system			Electronic release
Number of poles Image refixeree Rms. value measurement and "thermal memory" Nus manager softwaree Number of poles Image refixeree Apole Standard equipment Image refixeree Image refixeree 400/415 V 50 Hz Image refixeree Image refixeree Rated current = rated uninterrupted current Image refixeree Image refixeree Rated current = rated uninterrupted current Image refixeree Image refixeree Neutral conductor Xmo of poles Xmo of poles Stating range Image refixeree Image refixeree Overload trip Image refixeree Image refixeree Short-circuit releases Image refixeree Image refixeree Non-delayed Image refixeree Image refixeree	Construction size			NZM2
Standard equipment Image: Standard equipment Serve connection Switching capacity Ieu Ka 70 400/415 V 50 Hz Ieu Ka 70 Rated current = rated uninterrupted current I= 1u A 60 Neutral conductor In = 1u A 60 60 Setting range Image: Subscription of the set	Description			device R.m.s. value measurement and "thermal memory" USB interface for configuration and test function with Power Xpert Protection Manager software Optionally communication-capable with interface module and internal Modbus RTU
Switch capacityIcuKateIcuKate400/415 V 50 HzIcuKate70Rated current = rated uninterrupted current $I_n = I_u$ Au160Rated current = rated uninterrupted current $I_n = I_u$ Au160Neutral conductor% of phase conductor% of one	Number of poles			4 pole
400/415 V 50 HzIcuKA70Rated current = rated uninterrupted currentIIIRated current = rated uninterrupted currentIn= luAI00Neutral conductor% of phase conductor%60 - 100Setting rangeImage: ConductorImage: ConductorImage: ConductorOverload tripImage: ConductorImage: ConductorImage: ConductorShort-circuit releasesImage: ConductorImage: ConductorImage: ConductorNon-delayedImage: ConductorImage: Conductor <td< td=""><td>Standard equipment</td><td></td><td></td><td>Screw connection</td></td<>	Standard equipment			Screw connection
Rated current = rated uninterrupted current In = Iu A 160 Rated current = rated uninterrupted current In = Iu A 160 Neutral conductor % of phase conductor 0 - 60 - 100 Setting range	Switching capacity			
Rated current = rated uninterrupted currentIn = IuA60Neutral conductor% of phase conductor% of phase conductor% of of 0.00Setting rangeYYOverload tripYYImageYYShort-circuit releasesYYImageYYNon-delayedIi = In xYImageYY	400/415 V 50 Hz	I _{cu}	kA	70
Neutral conductor % of phase conductor	Rated current = rated uninterrupted current			
Setting range conductor Overload trip	Rated current = rated uninterrupted current	$I_n = I_u$	А	160
Overload trip Ir A Short-circuit releases Ir Ir Non-delayed Ir Ir Ir Ir Ir	Neutral conductor		%	0 - 60 - 100
Image: ProblemImage: ProblemImage: ProblemImage: ProblemImage: ProblemShort-circuit releasesImage: ProblemImage: ProblemImage: ProblemNon-delayedImage: ProblemImage: Proble	Setting range			
Short-circuit releases Non-delayed Image: Short-circuit releases Non-delayed Image: Short-circuit releases Short-circuit releases Image: Short-circuit releases <td>Overload trip</td> <td></td> <td></td> <td></td>	Overload trip			
Non-delayed $I_i = I_n \times$ 2-18	с‡	I _r	A	64 - 160
Delayed I _{sd} = I _r x 2 - 10	Non-delayed	l _i = l _n x		2 – 18
	Delayed	$I_{sd} = I_r \times \dots$		2 – 10

Technical data

General		
Standards		IEC/EN 60947
Protection against direct contact		Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing		Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature		
Ambient temperature, storage	°C	- 40 - + 70
Operation	°C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27	g	20 (half-sinusoidal shock 20 ms)
Safe isolation to EN 61140		
Between auxiliary contacts and main contacts	V AC	500

between the auxiliary contacts Mounting position		VAC	300 Vertical and 90° in all directions 90° 00° in all directions 90° 00° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions
Direction of incoming supply			as required
Degree of protection			
Device			In the operating controls area: IP20 (basic degree of protection)
Enclosures			With insulating surround: IP40 With door coupling rotary handle: IP66
Terminations			Tunnel terminal: IP10 Phase isolator and strip terminal: IP00
Other technical data (sheet catalogue)			Temperature dependency, Derating
Circuit-breakers			
Rated current = rated uninterrupted current	$I_n = I_u$	A	160
Rated surge voltage invariability	U _{imp}		
Main contacts		V	8000
Auxiliary contacts		V	6000
Rated operational voltage	Ue	V AC	690
Overvoltage category/pollution degree			111/3
Rated insulation voltage	Ui	V	690
Use in unearthed supply systems		V	≦ 690
Switching capacity			
Rated short-circuit making capacity	I _{cm}		
240 V	I _{cm}	kA	220
400/415 V	I _{cm}	kA	154
440 V 50/60 Hz	I _{cm}	kA	143
525 V 50/60 Hz	I _{cm}	kA	80
690 V 50/60 H	Ic	kA	40
Rated short-circuit breaking capacity I _{cn}	I _{cn}		
Icu to IEC/EN 60947 test cycle 0-t-C0	lcu	kA	
240 V 50/60 Hz	l _{cu}	kA	100
400/415 V 50/60 Hz	l _{cu}	kA	70
440 V 50/60 Hz	l _{cu}	kA	65
525 V 50/60 Hz	l _{cu}	kA	36
690 V 50/60 Hz	I _{cu}	kA	20
Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0	lcs	kA	
240 V 50/60 Hz	I _{cs}	kA	100
400/415 V 50/60 Hz	I _{cs}	kA	70
440 V 50/60 Hz	I _{cs}	kA	65
525 V 50/60 Hz	I _{cs}	kA	36
690 V 50/60 Hz		kA	6
	I _{cs}	NA.	o Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker.
Rated short-time withstand current		۲A	10
t = 0.3 s	I _{cw}	kA	1.9
t=1s	I _{cw}	kA	1.9
Utilization category to IEC/EN 60947-2	0		A
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		20000
Lifespan, electrical			

AC-1			
400 V 50/60 Hz	Operations		10000
415 V 50/60 Hz	Operations		10000
690 V 50/60 Hz	Operations		7500
Max. operating frequency		Ops/h	120
Total break time at short-circuit		ms	< 10
Terminal capacity			
Standard equipment			Screw connection
Optional accessories			Box terminal Tunnel terminal connection on rear
Round copper conductor			
Box terminal			
Solid		mm ²	1 × (10 - 16) 2 × (6 - 16)
Stranded		mm ²	1 x (25 - 185) 2 x (25 - 70)
Tunnel terminal			
Solid		mm ²	1 x 16
Stranded			
1-hole		mm ²	1 x (25 - 185)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm ²	1 x (25 - 185) 2 x (25 - 70)
Al circular conductor			
Tunnel terminal			
Solid		mm ²	1 x 16
Stranded			
Stranded		mm ²	1 x (25 - 185)
Cu strip (number of segments x width x segment thickness)			
Box terminal			
	min.	mm	2 x 9 x 0.8
	max.	mm	10 x 16 x 0.8
			(2x) 8 x 15.5 x 0,8
Bolt terminal and rear-side connection			
Flat copper strip, with holes	min.	mm	2 x 16 x 0.8
Flat copper strip, with holes	max.	mm	10 x 24 x 0.8
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M8
Direct on the switch			
	min. max.	mm mm	16 x 5 24 x 8
Control cables			
		mm ²	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

Design verification as per IEC/EN 61439

Technical data for design verification			
Rated operational current for specified heat dissipation	l _n	А	160
Equipment heat dissipation, current-dependent	P _{vid}	W	21.12
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			


10.2.2 Corrosion resistance	Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures	Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat	Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects	Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation	Meets the product standard's requirements.
10.2.5 Lifting	Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact	Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions	Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES	Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances	Meets the product standard's requirements.
10.5 Protection against electric shock	Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
10.8 Connections for external conductors	Is the panel builder's responsibility.
10.9 Insulation properties	
10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.


Technical data ETIM 7.0

Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])


protection (eci@ss10.0.1-27-37-04-09 [AJZ710013])		
Rated permanent current lu	А	160
Rated voltage	V	690 - 690
Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	70
Overload release current setting	А	64 - 160
Adjustment range short-term delayed short-circuit release	А	2 - 10
Adjustment range undelayed short-circuit release	А	2 - 18
Integrated earth fault protection		No
Type of electrical connection of main circuit		Screw connection
Device construction		Built-in device fixed built-in technique
Suitable for DIN rail (top hat rail) mounting		No
DIN rail (top hat rail) mounting optional		Yes
Number of auxiliary contacts as normally closed contact		0
Number of auxiliary contacts as normally open contact		0
Number of auxiliary contacts as change-over contact		0
With switched-off indicator		No
With under voltage release		No
Number of poles		4
Position of connection for main current circuit		Front side
Type of control element		Rocker lever
Complete device with protection unit		Yes
Motor drive integrated		No
Motor drive optional		Yes
Degree of protection (IP)		IP20

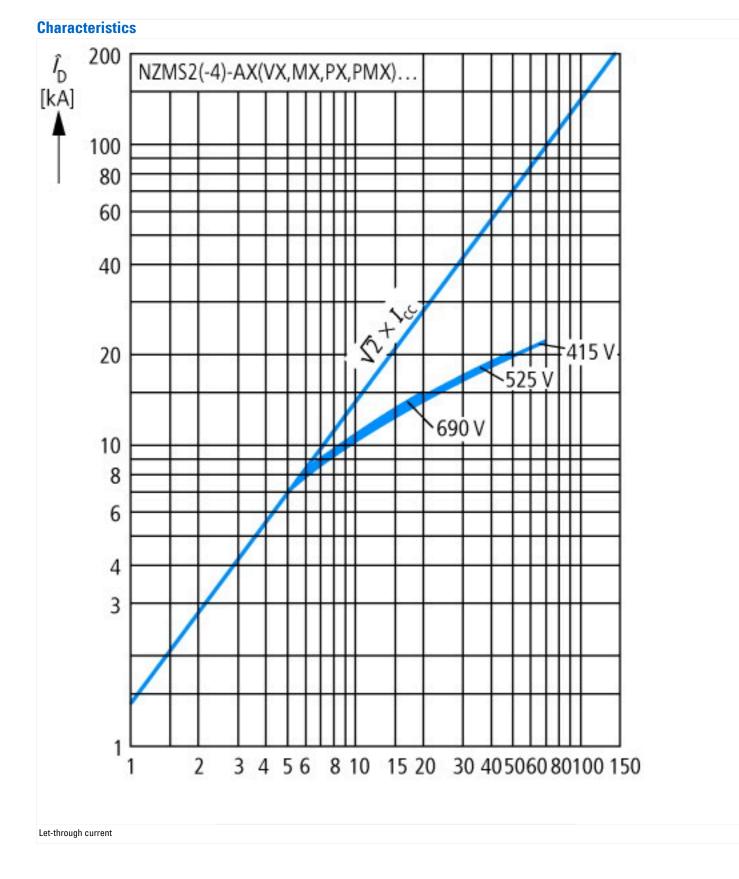

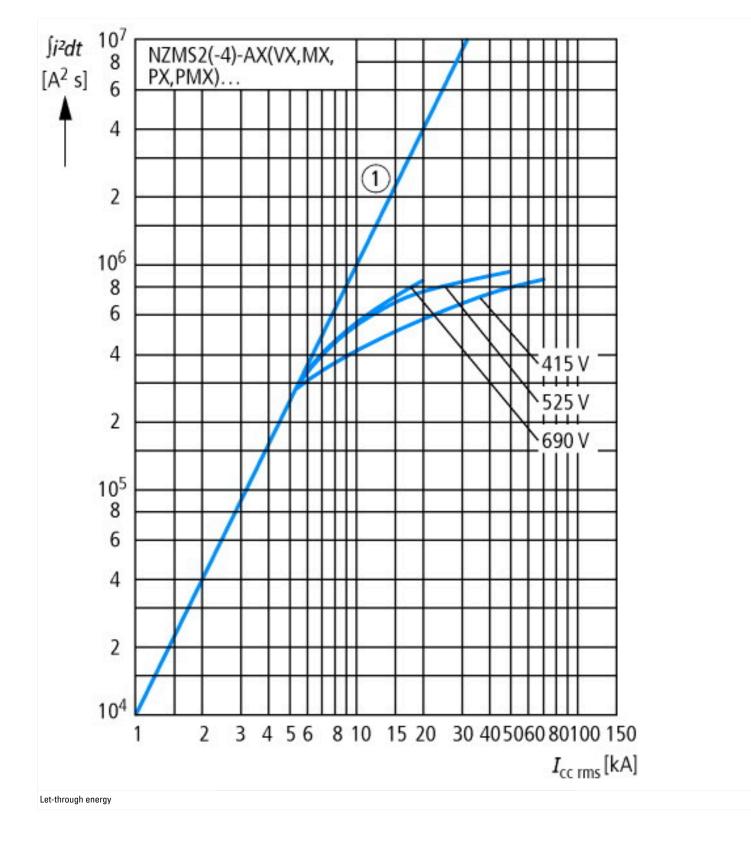



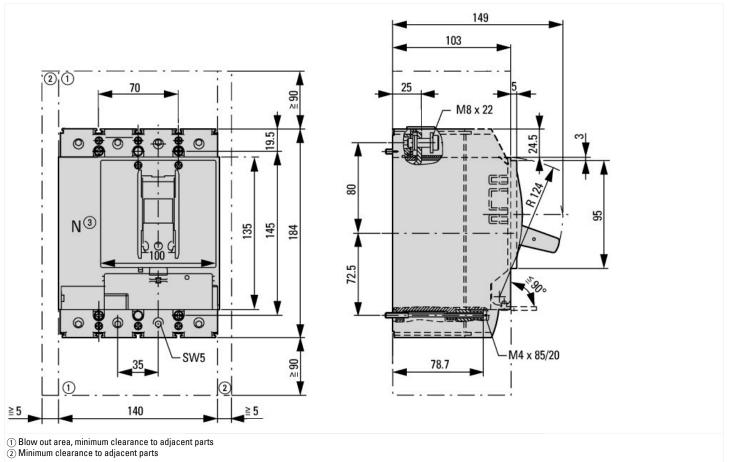

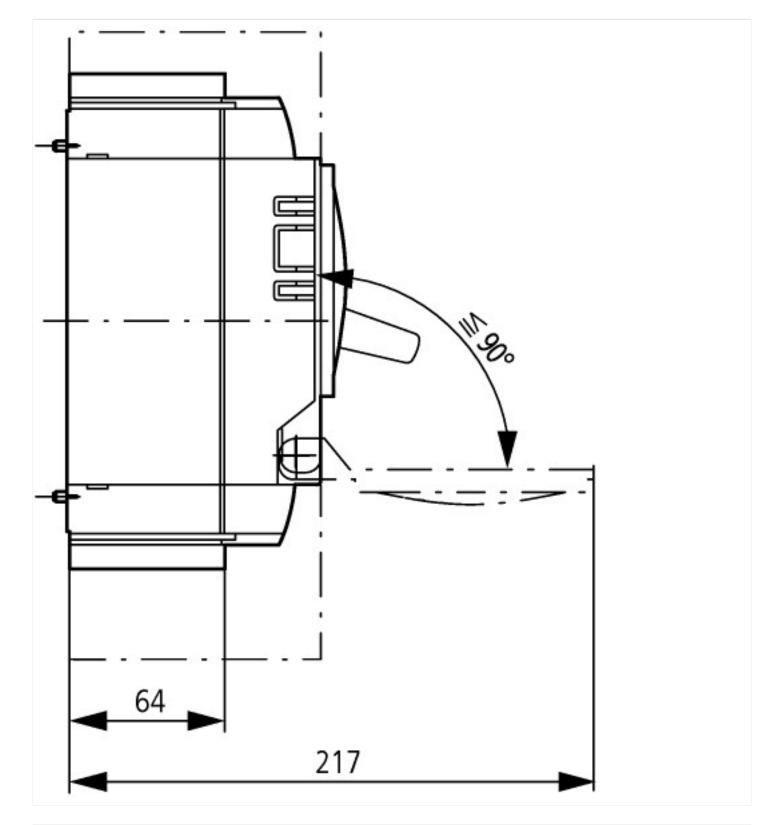

Additional product information (links)

IL012099ZU NZM2-PXR circuit-breaker, basic device, NZM2-PXR Circuit-Breaker, basic unit

IL012099ZU NZM2-PXR circuit-breaker, basic device, NZM2-PXR Circuit-Breaker, basic unit	https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL012099ZU2019_03.pdf
Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172
additional technical information for NZM power switch	https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf