DATASHEET - NZMS2-PX100

Part no.

Catalog No.



NZM2 PXR25 circuit breaker - integrated energy measurement class 1, 100A, 3p, Screw terminal

NZMS2-PX100 192246




Similar to illustration

Delivery program

Installation type Installation				
Shadard/Approval Fixed Installation type Fixed Release system Electronic release Construction size NZM Description Sile workshow protection and belayed and non-delayed short-circuit protective device electronic multiprotective electronic electronic multiprotective electronic multiprotective electro	Product range			Circuit-breaker
InstantFedFedRelease systemFedEctronic releaseConstruction sizeVEMEctronic releaseDescriptionCSI overload protection and delayed and non-delayed short-circuit protective device Class 1 encorement, and thermal memory Manager strongent supplied. Optionally communication-capable with internal Modbus RTU module or CAM Manager strongent supplied. Optionally communication-capable with internal Modbus RTU module or CAM Manager strongent supplied. Optionally communication-capable with internal Modbus RTU module or CAM Manager strongent supplied. Optionally communication-capable with internal Modbus RTU module or CAM Manager strongent supplied. Optionally communication-capable with internal Modbus RTU module or CAM Manager strongent supplied. Optionally communication-capable with internal Modbus RTU module or CAM Manager strongent supplied. Optionally communication-capable with internal Modbus RTU module or CAM Manager strongent supplied. Optionally communication-capable with internal Modbus RTU module or CAM Manager strongent supplied. Optionally communication-capable with internal Modbus RTU module or CAM Manager strongent supplied. Optionally communication-capable with internal Modbus RTU module or CAM Manager strongent supplied. Optionally communication-capable with internal Modbus RTU module or CAM Manager strongent supplied. Optionally communication-capable with internal Modbus RTU module or CAM Manager strongent supplied. Optionally communication-capable with internal Modbus RTU module or CAM Manager strongent supplied. Optionally communication-capable with internal Modbus RTU module or CAM Manager strongent supplied. Optionally communication-capable with internal Modbus RTU module or CAM Manager strongent supplied. Optionally communication-capable	Protective function			Systems, cable, selectivity and generator protection
Release system Extromic release Construction size ZM2 Description Silverice/add protection and delayed and non-delayed short-circuit protective divide divid	Standard/Approval			IEC
Construction size KM2 Description Silver back protection and delayed and non-delayed short-circuit protective value of class 1 energy measurement, r.m.s. value measurement, and thermal memory Value or CAM Wanager software Number of poles 3pole Standard equipment 3pole Stortching capacity 3pole add/15 V50 Hz Kanager software Reted current = rated uninterrupted current Kanager Overload trip Image: Marking tripped software Stort-circuit releases Image: Marking tripped software Short-circuit releases Image: Marking tripped software Non-delayed Image: Marking tripped software Non-delayed Image: Marking tripped software Non-delayed Image: Marking tripped software	Installation type			Fixed
Description Is were and delayed and non-delayed short-circuit protective Gass 1 energy measurement, rm.s. value measurement, and 'thermal memory' USB interface for configuration and test function with Power Xpert Protection (Number of poles) Number of poles 3 pole Standard equipment 3 pole Standard equipment 5 pole AdvA15 V50 h/z rerew connection Rated current = rated uninterrupted current 1 pel yee Number of rotes 1 pel yee Overload trip 1 pel yee Short-circuit releases 1 pel yee Short-circuit releases 1 pel yee Non-delayed I pel yee	Release system			Electronic release
Number of poles Image: Software interface of configuration and test function with Power Xpert Protection Manager software interface module in equipment supplied. Optionally communication-capable with internal Modbus RTU module or CAM Number of poles 3 pole Standard equipment Image: Software interface module in equipment supplied. Optionally communication-capable with internal Modbus RTU module or CAM Switching capacity Image: Software interface module in equipment supplied. ModWats V50 Hz Image: Software interface module in equipment supplied. Rated current = rated uninterrupted current Image: Software interface module in equipment supplied. Nor-delayed Image: Software interface module in equipment supplied. Short-circuit releases Image: Software interface module in equipment supplied. Non-delayed Image: Software interface module in equipment supplied.	Construction size			NZM2
Standard equipmentIckIckScrew connectionSwitching capacityIcuKaIcu400/415 V 50 HzIcuKa70Rated current = rated uninterrupted currentIcuKaIcuRated current = rated uninterrupted currentIcuKaIcuNor-delayedIcuKaIcuIcuNon-delayedIcuIcuKaIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcuNon-delayedIcuIcuIcuIcu	Description			device Class 1 energy measurement, r.m.s. value measurement, and "thermal memory" USB interface for configuration and test function with Power Xpert Protection Manager software Interface module in equipment supplied.
Switching capacity Icu KA 70 400/415 V 50 Hz Icu KA 70 Rated current = rated uninterrupted current Icu KA 70 Rated current = rated uninterrupted current Icu Icu KA 70 Setting range Icu Icu A 70 Overload trip Icu Icu A 70 Short-circuit releases Icu Icu Icu Icu Non-delayed Icu Icu Icu Icu	Number of poles			3 pole
400/415 V 50 HzIcuKA70Rated current = rated uninterrupted currentIn = IuInInRated current = rated uninterrupted currentIn = IuAInOverload tripInInInInOverload tripIn<	Standard equipment			Screw connection
Rated current = rated uninterrupted current In = Iu A 10 Rated current = rated uninterrupted current In = Iu A 10 Overload trip Image Image Image Overload trip Image Image Image Short-circuit releases Image Image Image Non-delayed Image Image Image Image	Switching capacity			
Rated current = rated uninterrupted current In = Iu A 100 Setting range Image: Setting range Image: Setting range Image: Setting range Short-circuit releases Image: Setting range Image: Setting range Image: Setting range Non-delayed Image: Setting range Image: Setting range Image: Setting range Non-delayed Image: Setting range Image: Setting range Image: Setting range	400/415 V 50 Hz	I _{cu}	kA	70
Setting range Non-delayed Non-delayed I= In x	Rated current = rated uninterrupted current			
Overload trip Ir A Image: Construction of the set	Rated current = rated uninterrupted current	$I_n = I_u$	А	100
Image: A set in the set in t	Setting range			
Short-circuit releases Non-delayed I = In x 2 - 18	Overload trip			
Non-delayed Image: Non-delayed <	с‡	I _r	A	40 - 100
Delayed I _{sd} = I _r x 2 - 10	Non-delayed	$I_i = I_n \mathbf{x} \dots$		2 – 18
	Delayed	I _{sd} = I _r x		2 – 10

Technical data

General		
Standards		IEC/EN 60947
Protection against direct contact		Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing		Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature		
Ambient temperature, storage	°C	- 40 - + 70
Operation	°C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27	g	20 (half-sinusoidal shock 20 ms)
Safe isolation to EN 61140		
Between auxiliary contacts and main contacts	V AC	500
between the auxiliary contacts	V AC	300
Mounting position		Vertical and 90° in all directions



With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical

			- NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions
Direction of incoming supply			as required
Degree of protection			
Device			In the operating controls area: IP20 (basic degree of protection)
Enclosures			With insulating surround: IP40 With door coupling rotary handle: IP66
Terminations			Tunnel terminal: IP10 Phase isolator and strip terminal: IP00
Other technical data (sheet catalogue)			Temperature dependency, Derating
Circuit-breakers	1 -1	٨	100
Rated current = rated uninterrupted current	$I_n = I_u$	A	100
Rated surge voltage invariability	U _{imp}		
Main contacts		V	8000
Auxiliary contacts		V	6000
Rated operational voltage	Ue	V AC	690
Overvoltage category/pollution degree			111/3
Rated insulation voltage	Ui	V	690
Use in unearthed supply systems		V	≦ 690
Switching capacity			
Rated short-circuit making capacity	I _{cm}		
240 V	I _{cm}	kA	220
400/415 V	I _{cm}	kA	154
440 V 50/60 Hz	I _{cm}	kA	143
525 V 50/60 Hz	I _{cm}	kA	80
690 V 50/60 H	lc	kA	40
Rated short-circuit breaking capacity I _{cn}	I _{cn}		
Icu to IEC/EN 60947 test cycle 0-t-C0	Icu	kA	
240 V 50/60 Hz	I _{cu}	kA	100
400/415 V 50/60 Hz	I _{cu}	kA	70
440 V 50/60 Hz	I _{cu}	kA	65
525 V 50/60 Hz	I _{cu}	kA	36
690 V 50/60 Hz	I _{cu}	kA	20
Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0	lcs	kA	-
240 V 50/60 Hz	Ics I _{cs}	kA	100
400/415 V 50/60 Hz		kA	70
	l _{cs}		
440 V 50/60 Hz	I _{cs}	kA	65
525 V 50/60 Hz	l _{cs}	kA	36
690 V 50/60 Hz	I _{cs}	kA	6
			Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker.
Rated short-time withstand current			
t = 0.3 s	I _{cw}	kA	1.9
t = 1 s	I _{cw}	kA	1.9
Utilization category to IEC/EN 60947-2			A
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		20000
Lifespan, electrical			
AC-1			
400 V 50/60 Hz	Operations		10000

415 V 50/60 Hz	Operations		10000
690 V 50/60 Hz	Operations		7500
Max. operating frequency	oporationo	Ops/h	120
Total break time at short-circuit		ms	< 10
Terminal capacity			
Standard equipment			Screw connection
Optional accessories			Box terminal Tunnel terminal connection on rear
Round copper conductor			
Box terminal			
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm ²	1 x (25 - 185) 2 x (25 - 70)
Tunnel terminal			
Solid		mm ²	1 x 16
Stranded			
1-hole		mm ²	1 x (25 - 185)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm ²	1 x (25 - 185) 2 x (25 - 70)
Al circular conductor			
Tunnel terminal			
Solid		mm ²	1 x 16
Stranded			
Stranded		mm ²	1 x (25 - 185)
Cu strip (number of segments x width x segment thickness)			
Box terminal			
	min.	mm	2 x 9 x 0.8
	max.	mm	10 x 16 x 0.8 (2x) 8 x 15.5 x 0,8
Bolt terminal and rear-side connection			
Flat copper strip, with holes	min.	mm	2 x 16 x 0.8
Flat copper strip, with holes	max.	mm	10 x 24 x 0.8
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M8
Direct on the switch			
	min.	mm	16 × 5
	max.	mm	24 x 8
Control cables			
		mm ²	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

Design verification as per IEC/EN 61439

Technical data for design verification			
Rated operational current for specified heat dissipation	I _n	А	100
Equipment heat dissipation, current-dependent	P _{vid}	W	8.25
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.


10.2.3.2 Verification of resistance of insulating materials to normal heat	Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects	Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation	Meets the product standard's requirements.
10.2.5 Lifting	Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact	Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions	Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES	Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances	Meets the product standard's requirements.
10.5 Protection against electric shock	Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
10.8 Connections for external conductors	Is the panel builder's responsibility.
10.9 Insulation properties	
10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.


Technical data ETIM 7.0

Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])


Rated permanent current lu	А	100
Rated voltage	V	690 - 690
Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	70
Overload release current setting	А	40 - 100
Adjustment range short-term delayed short-circuit release	А	2 - 10
Adjustment range undelayed short-circuit release	А	2 - 18
Integrated earth fault protection		No
Type of electrical connection of main circuit		Screw connection
Device construction		Built-in device fixed built-in technique
Suitable for DIN rail (top hat rail) mounting		No
DIN rail (top hat rail) mounting optional		Yes
Number of auxiliary contacts as normally closed contact		0
Number of auxiliary contacts as normally open contact		0
Number of auxiliary contacts as change-over contact		0
With switched-off indicator		No
With under voltage release		No
Number of poles		3
Position of connection for main current circuit		Front side
Type of control element		Rocker lever
Complete device with protection unit		Yes
Motor drive integrated		No
Motor drive optional		Yes
Degree of protection (IP)		IP20

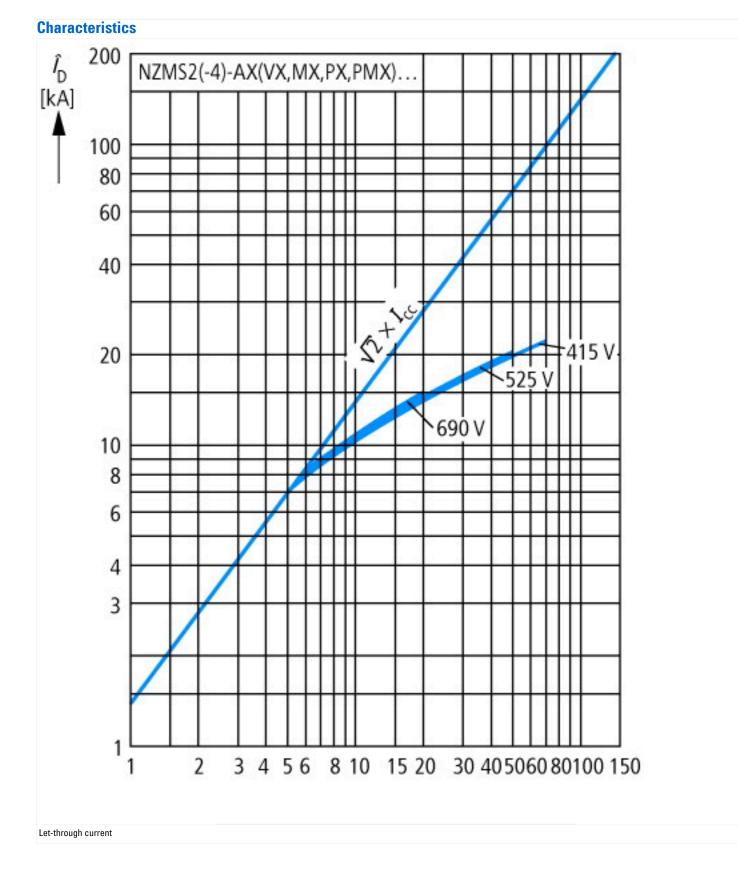

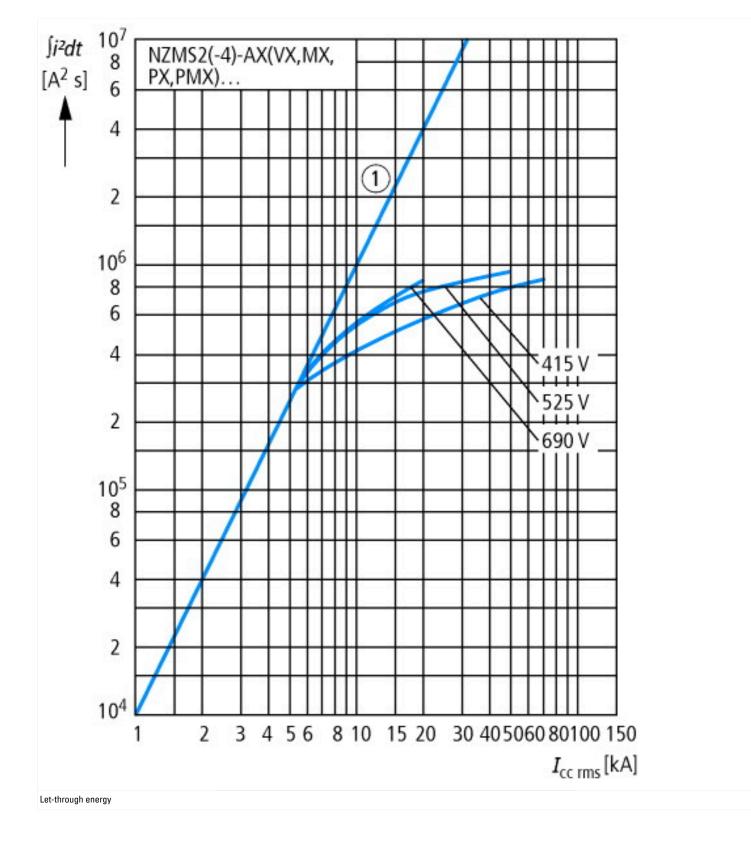

Dimensions

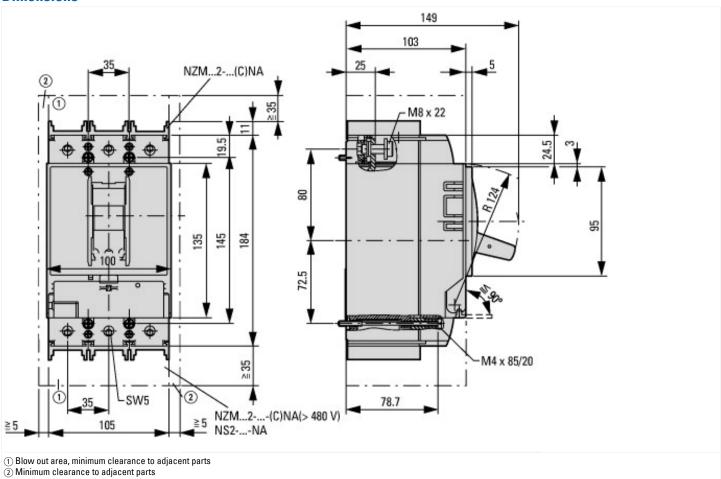

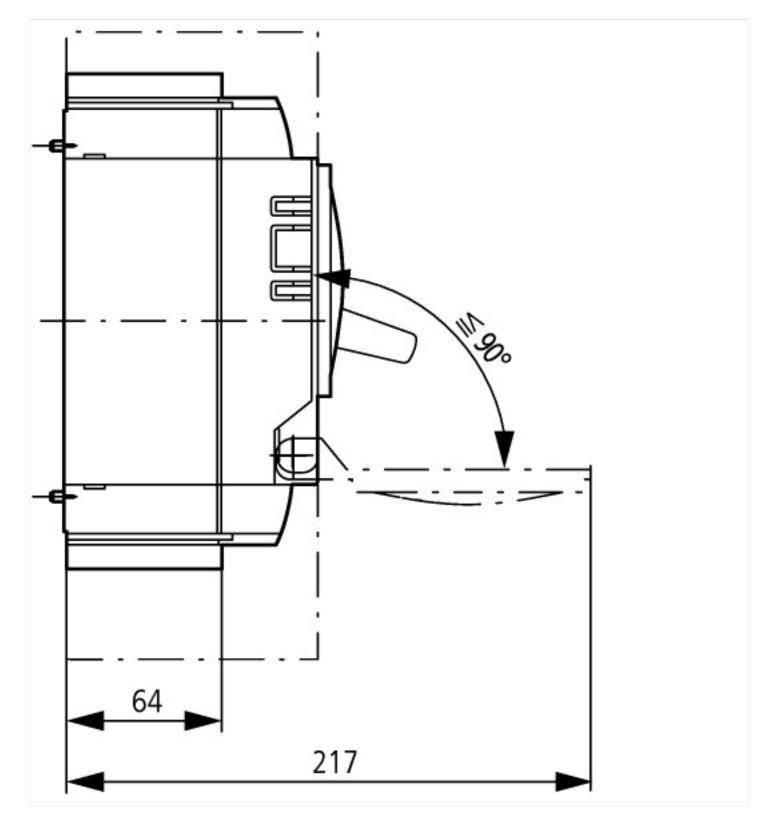

Additional product information (links)

Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172
additional technical information for NZM power switch	https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf