### DATASHEET - NZMS3-4-PX630/VAR-SVE



NZM3 PXR25 circuit breaker - integrated energy measurement class 1, 630A, 4p, variable, plug-in technology



Part no. Catalog No. NZMS3-4-PX630/VAR-SVE 192300

Similar to illustration

### **Delivery program**

Protective function     Standard/Approval     Standard/Approval     Example of the selectivity and generator protection       Standard/Approval     File     File     Example of the selectivity and generator protection       Installation type     Plug-in units     Electronic release       Construction size     NZM3       Description     Siloverload protection and delayed and non-delayed short-circuit protective devices       Construction size     NZM3       Number of poles     Siloverload protection and delayed and non-delayed short-circuit protective devices       Standard equipment     Y       Y				
Standard/Approval     IEC       Installation type     IEC       Release system     IEC       Construction size     IEC       Description     IEC       Description     IEC       Number of poles     IEC       Standard (Approval     IEC       Standard equipment     IEC       Reled current = rated uninterrupted current     IEC       IEC     IEC       Overload trip     IEC       Dout loco     IEC       Standard	Product range			Circuit-breaker
Instalturing in the service of the s	Protective function			Systems, cable, selectivity and generator protection
Release system       Image: Struction size       Image: Struction size <td>Standard/Approval</td> <td></td> <td></td> <td>IEC</td>	Standard/Approval			IEC
Construction size     NZM3       Description     LSI overload protection and delayed and non-delayed short-tircuit protective device device for configuration and test function with Power Xper Protection Manager software interface mobile in equipment supplied.       Number of poles     4 pole       Standard equipment     4 pole       Standard equipment     Keu     Kat       Addyt15 V 50 Hz     Kat     5 crew connection       Rated current = rated uninterrupted current     Number of poles     Softwarter of the softwarter of t	Installation type			Plug-in units
Description       Kines	Release system			Electronic release
Number of poles     Key Reference on Configuration and test function with Power Xpert Protection Wind Wareare Interface module in equipment supplied. Optionally communication-capable with internal Modules RTU module or CAM       Number of poles     Key Reference on Configuration and test function with Power Xpert Protection Interface module in equipment supplied. Optionally communication-capable with internal Modules RTU module or CAM       Number of poles     Imager of Subware Point Supplied. Potentiation-capable with internal Modules RTU module or CAM       Standard equipment     Imager of Subware Point Supplied. Potentiation-capable with internal Modules RTU module or CAM       Standard equipment     Imager of Subware Point Supplied. Potentiation-capable with internal Modules RTU module or CAM       Standard equipment     Image of Subware Point Supplied. Potentiation-capable with internal Modules RTU module or CAM       Standard equipment     Imager of Subware Point Supplied. Potentiation-capable with internal Modules RTU module or CAM       Standard equipment     Imager of Subware Point Supplied. Potentiation-capable with internal Modules RTU module or CAM       Rated current = rated uninterrupted current     Imager of Subware Potentiation-capable RTU module or CAM       Neutral conductor     Imager of Subware Potentiation Potentiation Potentiation-Capable RTU module or CAM       Overload trip     Imager of Subware Potentiation Potenti	Construction size			NZM3
Standard equipmentImage: Standard equipmentServe connectionSwitching capacityImage: Standard equipmentImage: Standard equipmentA00/415 V 50 HzImage: Standard equipmentImage: Standard equipmentRated current = rated uninterrupted currentImage: Standard equipmentImage: Standard equipmentRated current = rated uninterrupted currentImage: Standard equipmentImage: Standard equipmentNeutral conductorImage: Standard equipmentImage: Standard equipmentOverload tripImage: Standard equipmentImage: Standard equipmentStort-circuit releasesImage: Standard equipmentImage: Standard equipmentNon-delayedImage: Standard equipmentImage: Standard equipmentNon-delayedImage: Standard equipmentImage: Standard equipmentImage: Standard equipmentImage: Standard equipmentImage: Standard equipmentNon-delayedImage: Standard equipmentImage: Standard equipment<	Description			device Class 1 energy measurement, r.m.s. value measurement, and "thermal memory" USB interface for configuration and test function with Power Xpert Protection Manager software Interface module in equipment supplied.
Switching capacity       Icu       Katel       Icu       Katel       To         Rated current = rated uninterrupted current       In = Iu       A       60       60         Rated current = rated uninterrupted current       In = Iu       A       60       60       100         Neutral conductor       % of phase conductor       % of phase conductor       % of phase conductor       % of phase       % of 0.00         Steting range       Y       Y       Y       Y       Y         Överload trip       Y       Y       Y       Y       Y         İn = Iu       Ka       A       Sa       Sa       Sa         Non-delayed       Ir       Ir       A       Sa       Sa       Sa	Number of poles			4 pole
400/415 V 50 Hz     Icu     KA     70       Rated current = rated uninterrupted current     In = Iu     KA     600       Rated current = rated uninterrupted current     In = Iu     KA     600       Neutral conductor     % of phase conductor     % of phase conductor     % of phase conductor     % of phase conductor       Overload trip     Y     Y     Y     Y       Image: Short-circuit releases     Y     Y     Y       Non-delayed     Y     Y     Y	Standard equipment			Screw connection
Rated current = rated uninterrupted current     In = Iu     A     60       Rated current = rated uninterrupted current     In = Iu     A     60       Neutral conductor     So of phase conductor     % of phase cond	Switching capacity			
Rated current = rated uninterrupted currentIn = IuA60Neutral conductor% of phase conductor% of of hose conductor% of of hose conductor% of of hose conductor% of of hose conductorSetting rangeYYYOverload tripYYYShort-circuit releasesIrA\$25 - 630Non-delayedIi = In xYYNon-delayedIi = In xYY	400/415 V 50 Hz	I <sub>cu</sub>	kA	70
Neutral conductor% of phase conductor% of phase conductor% of of - 100Setting range </td <td>Rated current = rated uninterrupted current</td> <td></td> <td></td> <td></td>	Rated current = rated uninterrupted current			
conductor       Setting range     Image: Conductor       Overload trip     Image: Conductor       Image: Conductor     Image: Conductor       Image: Conductor     Image: Conductor       Short-circuit releases     Image: Conductor       Image: Conductor     Image: Conductor       Non-delayed     Image: Conductor       Image: Conductor     Image: Conductor	Rated current = rated uninterrupted current	$I_n = I_u$	А	630
Overload trip     Ir     A     252 - 630       Short-circuit releases     Ir     Ir     Ir       Non-delayed     Ir     Ir     Ir	Neutral conductor		%	0 - 60 - 100
Image:	Setting range			
Short-circuit releases     Non-delayed     I = In x     2 - 8	Overload trip			
Non-delayed I <sub>i</sub> = I <sub>n</sub> x 2-8	с‡	l <sub>r</sub>	A	252 - 630
Delayed I <sub>sd</sub> = I <sub>r</sub> x 1.5 – 7	Non-delayed	l <sub>i</sub> = l <sub>n</sub> x		2-8
	Delayed	$I_{sd} = I_r x \dots$		1.5 – 7

# **Technical data**

General		
Standards		IEC/EN 60947
Protection against direct contact		Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing		Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature		
Ambient temperature, storage	°C	- 40 - + 70
Operation	°C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27	g	20 (half-sinusoidal shock 20 ms)
Safe isolation to EN 61140		

Between auxiliary contacts and main contacts		V AC	500	
between the auxiliary contacts		V AC	300	
Mounting position			Vertical and 90° in all directions With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)4: vertical and 90° in all directions	
Direction of incoming supply			as required	
Degree of protection				
Device			In the operating controls area: IP20 (basic degree of protection)	
Enclosures			With insulating surround: IP40 With door coupling rotary handle: IP66	
Terminations			Tunnel terminal: IP10 Phase isolator and strip terminal: IP00	
Other technical data (sheet catalogue)			Temperature dependency, Derating	
Circuit-breakers	1	٨	630	
Rated current = rated uninterrupted current	I <sub>n</sub> = I <sub>u</sub>	A	630	
Rated surge voltage invariability	U <sub>imp</sub>	V	0000	
Main contacts		v v	8000	
Auxiliary contacts Rated operational voltage	U <sub>e</sub>	V V AC	6000 690	
Overvoltage category/pollution degree	0 <sub>e</sub>	V AU	111/3	
Rated insulation voltage	Ui	V	690	
Use in unearthed supply systems	01	v	≦ 690	
Switching capacity		v	= 050	
Rated short-circuit making capacity	I <sub>cm</sub>			
240 V	I <sub>cm</sub>	kA	220	
400/415 V	I <sub>cm</sub>	kA	154	
440 V 50/60 Hz	I <sub>cm</sub>	kA	143	
525 V 50/60 Hz	I <sub>cm</sub>	kA	80	
690 V 50/60 H	lc	kA	50	
Rated short-circuit breaking capacity I <sub>cn</sub>	I <sub>cn</sub>			
Icu to IEC/EN 60947 test cycle 0-t-C0	lcu	kA		
240 V 50/60 Hz	I <sub>cu</sub>	kA	100	
400/415 V 50/60 Hz	I <sub>cu</sub>	kA	70	
440 V 50/60 Hz	I <sub>cu</sub>	kA	65	
525 V 50/60 Hz	l <sub>cu</sub>	kA	36	
690 V 50/60 Hz	l <sub>cu</sub>	kA	25	
Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0	lcs	kA		
240 V 50/60 Hz	I <sub>cs</sub>	kA	100	
400/415 V 50/60 Hz	I <sub>cs</sub>	kA	70	
440 V 50/60 Hz	l <sub>cs</sub>	kA	65	
525 V 50/60 Hz	l <sub>cs</sub>	kA	18	
690 V 50/60 Hz	I <sub>cs</sub>	kA	6 Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker.	1
Rated short-time withstand current				
t = 0.3 s	I <sub>cw</sub>	kA	3.3	
t = 1 s	I <sub>cw</sub>	kA	3.3	
Utilization category to IEC/EN 60947-2			A	
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		15000	

Lifespan, electrical			
AC-1			
400 V 50/60 Hz	Operations		5000
415 V 50/60 Hz	Operations		5000
690 V 50/60 Hz	Operations		3000
Max. operating frequency		Ops/h	60
Total break time at short-circuit		ms	< 10
Terminal capacity			
Standard equipment			Screw connection
Accessories required			NZM3-4-XSVS
Optional accessories			Box terminal Tunnel terminal connection on rear
Round copper conductor			
Box terminal			
Solid		mm <sup>2</sup>	2 x 16
Stranded Tunnel terminal		mm <sup>2</sup>	1 x (35 - 240) 2 x (25-120)
Solid		2	1 x 16
		mm <sup>2</sup>	
Stranded		2	1/10_1051
1-hole		mm <sup>2</sup>	1 x (16 - 185)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm <sup>2</sup>	1 x 16 2 x 16
Stranded		mm <sup>2</sup>	1 x (25 - 240) 2 x (25 - 240)
Connection width extension		mm <sup>2</sup>	
Connection width extension		mm <sup>2</sup>	2 x 300
Al circular conductor			
Tunnel terminal			
Solid		mm <sup>2</sup>	1 x 16
Stranded			
Stranded		mm <sup>2</sup>	1 x (25 - 185) <sup>2)</sup>
Double hole		mm <sup>2</sup>	1 x (50 - 240)
			2 x (50 - 240)
			<sup>2)</sup> Up to 240 mm <sup>2</sup> can be connected depending on the cable manufacturer.
Cu strip (number of segments x width x segment thickness)			
Box terminal			
	min.	mm	6 x 16 x 0.8
	max.	mm	10 x 24 x 1.0 + 5 x 24 x 1.0 (2 x) 8 x 24 x 1.0
Bolt terminal and rear-side connection	min	-	6 v 16 v 0 0
Flat copper strip, with holes	min.	mm	6 x 16 x 0.8
Flat copper strip, with holes Connection width extension	max.	mm	10 x 32 x 1.0 + 5 x 32 x 1.0 (2 x) 10 x 50 x 1.0
Connection Width x thickness)	mm	mm	
Bolt terminal and rear-side connection			
Screw connection			M10
Direct on the switch			
	min.	mm	20 × 5
	max.	mm	30 x 10
			+ 30 × 5
Connection width extension		mm	
Connection width extension	max.	mm	2 x (10 x 50)
Control cables			

mm<sup>2</sup> 1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

## Design verification as per IEC/EN 61439

besign vermeation as per reorem 01-05			
Technical data for design verification			
Rated operational current for specified heat dissipation	l <sub>n</sub>	А	630
Equipment heat dissipation, current-dependent	P <sub>vid</sub>	W	119.07
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances			Meets the product standard's requirements.
10.5 Protection against electric shock			Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components			Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections			Is the panel builder's responsibility.
10.8 Connections for external conductors			Is the panel builder's responsibility.
10.9 Insulation properties			
10.9.2 Power-frequency electric strength			Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage			Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material			Is the panel builder's responsibility.
10.10 Temperature rise			The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function			The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

#### **Technical data ETIM 7.0**


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])


Rated permanent current lu	А	630
Rated voltage	V	690 - 690
Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	70
Overload release current setting	А	252 - 630
Adjustment range short-term delayed short-circuit release	А	1.5 - 7
Adjustment range undelayed short-circuit release	А	2 - 8
Integrated earth fault protection		No
Type of electrical connection of main circuit		Other
Device construction		Built-in device plug-in technique
Suitable for DIN rail (top hat rail) mounting		No
DIN rail (top hat rail) mounting optional		No
Number of auxiliary contacts as normally closed contact		0
Number of auxiliary contacts as normally open contact		0
Number of auxiliary contacts as change-over contact		0
With switched-off indicator		No


With under voltage release	No
Number of poles	4
Position of connection for main current circuit	Connection at separate chassis part
Type of control element	Rocker lever
Complete device with protection unit	Yes
Motor drive integrated	No
Motor drive optional	Yes
Degree of protection (IP)	IP20


## **Characteristics**

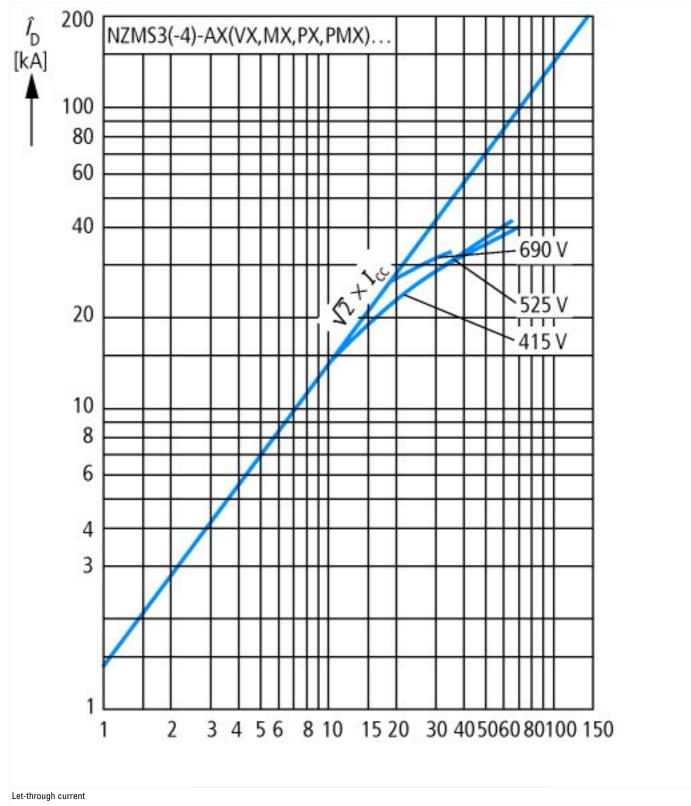

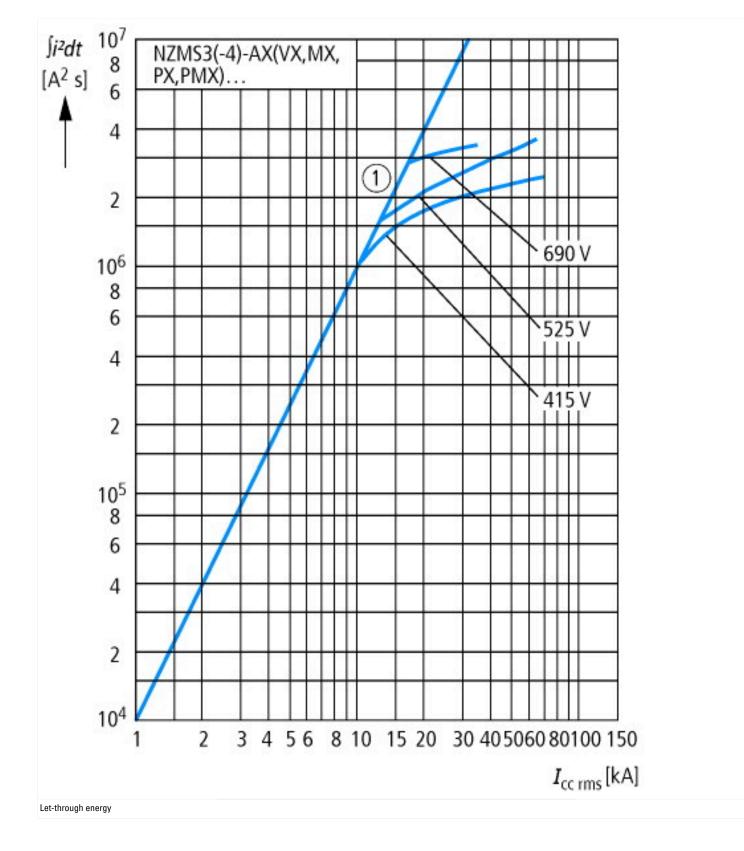

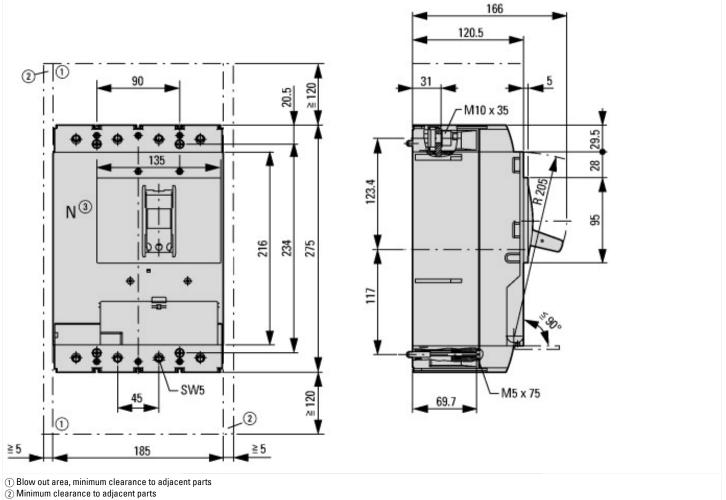

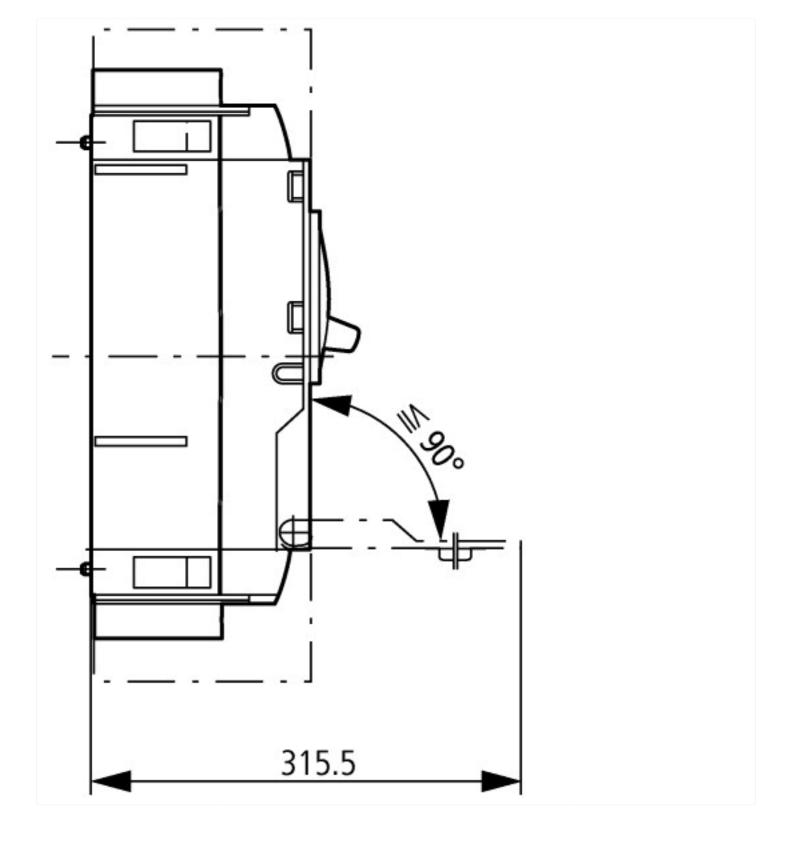

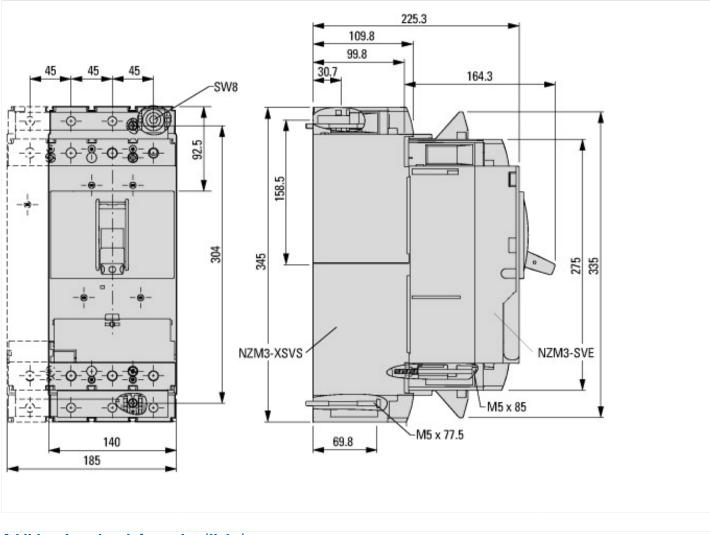

### Additional product information (links)

Temperature dependency, Derating

additional technical information for NZM power switch

http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172 https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm\_technic\_de\_en.pdf